specialty lighting industries

Light efficiency:

74 Lumen/Watt

Light quality:

CRI: 97.0


Output: 1036 lm

Peak: 2129 cd

Power: 14.0 W



Beam angle

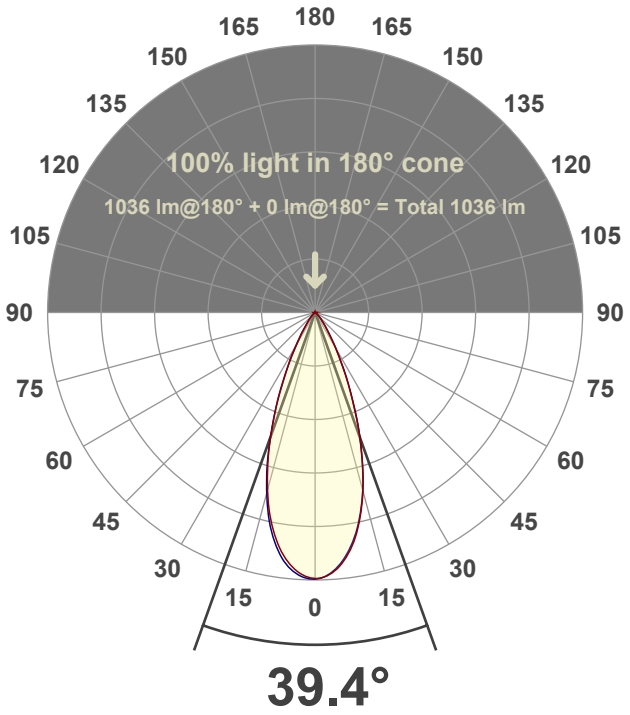

Test number:
CR3D-RF-DR-AD14-45MM 36°-325mA-3018
Luminaire Model:


Date:
7/15/2026

LUM: 1036


3000 K

***Variation due to source size, bezel geometry, or secondary optics**

Spectra

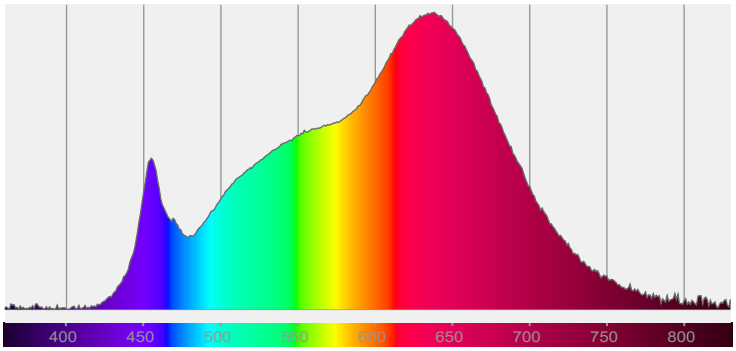

CRI: 97.0 (R1-R8)

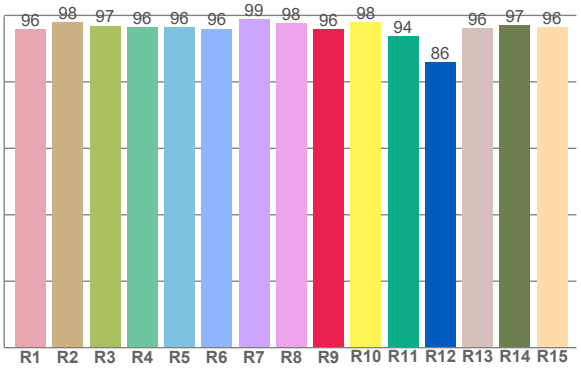

Color parameters

	Color rendering index	Red component	Color fidelity	Color gamut	Color quality scale	Color coordinate cie 1931	Color coordinate cie 1931	Color coordinate	Color coordinate	Color diviation from black body
	CRI	CRI R9	TM30 R_f	TM30 R_g	CQS	x	y	u	v	Δuv
	97.0	95.8	94.5	101.3	95.9	0.435	0.401	0.251	0.347	-0.0012

specialty lighting industries


TM-30Color

R_f 94.5


Fidelity index R_f

R_g 101.3


Gammut index R_g

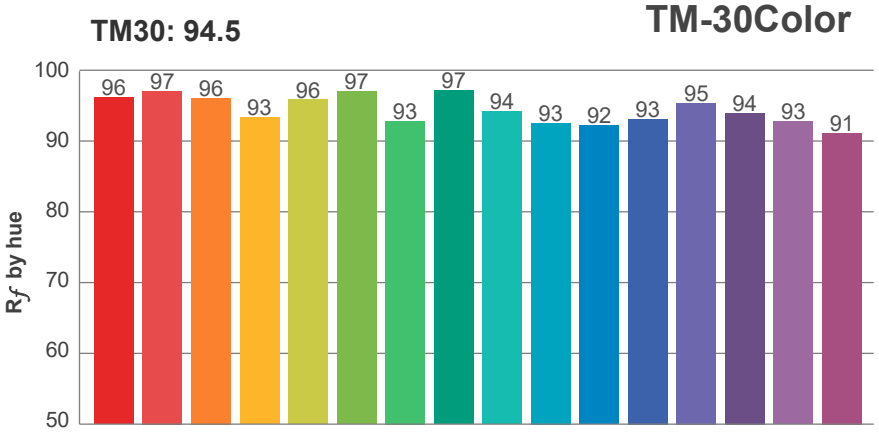


		Graphic shifts (%)	
Hue Bin	R_f	Chroma	Hue
1	96	0%	1%
2	97	1%	-1%
3	96	0%	-1%
4	93	-4%	-3%
5	96	-3%	1%
6	97	0%	2%
7	93	-2%	4%
8	97	1%	1%
9	94	1%	4%
10	93	2%	5%
11	92	4%	5%
12	93	4%	-1%
13	95	1%	-3%
14	94	3%	-3%
15	93	0%	-1%
16	91	3%	-7%

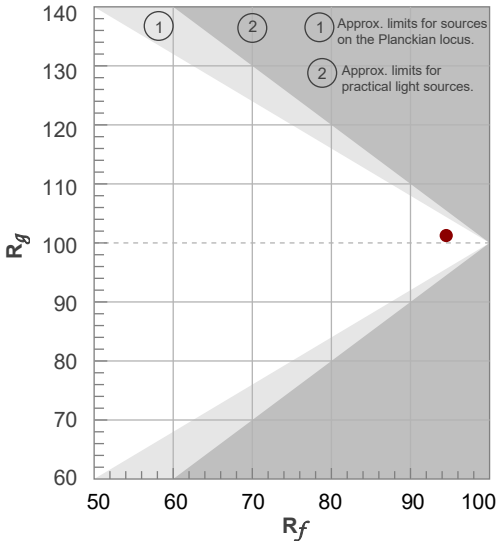


Color vector graphics

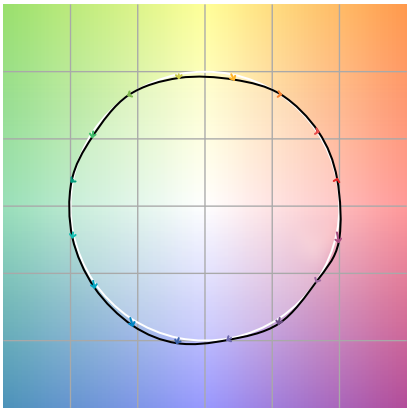

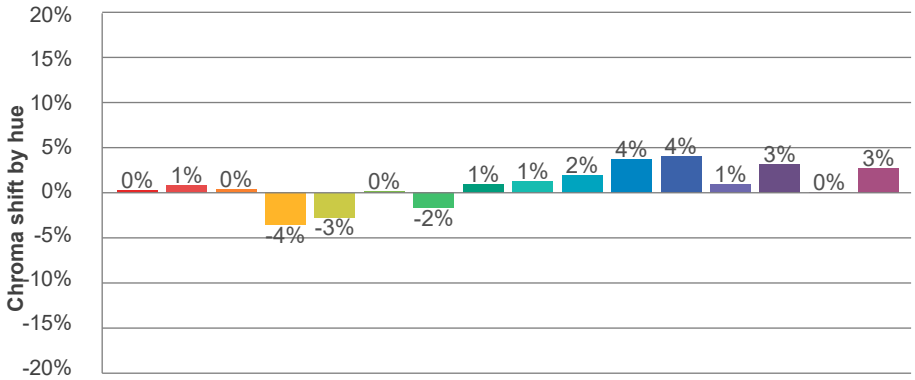

Color distortion




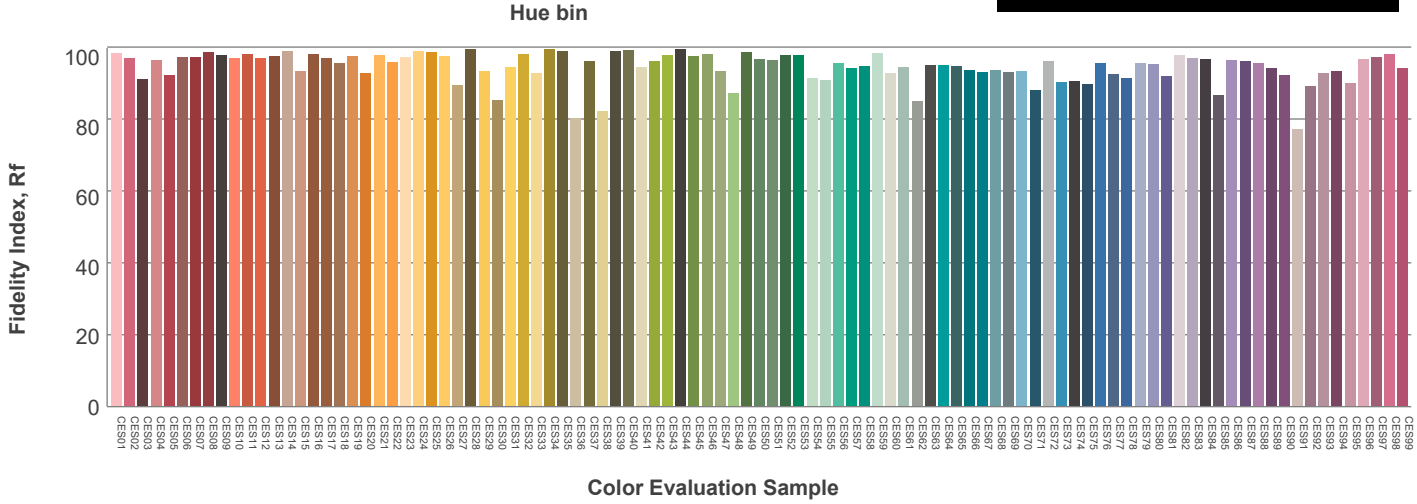

www.specialty-lighting.com As a result of our continuous improvement, values are subject to change without notice. These are delivered results and can vary +/- 10% from published source data range.

specialty lighting industries

Beam details

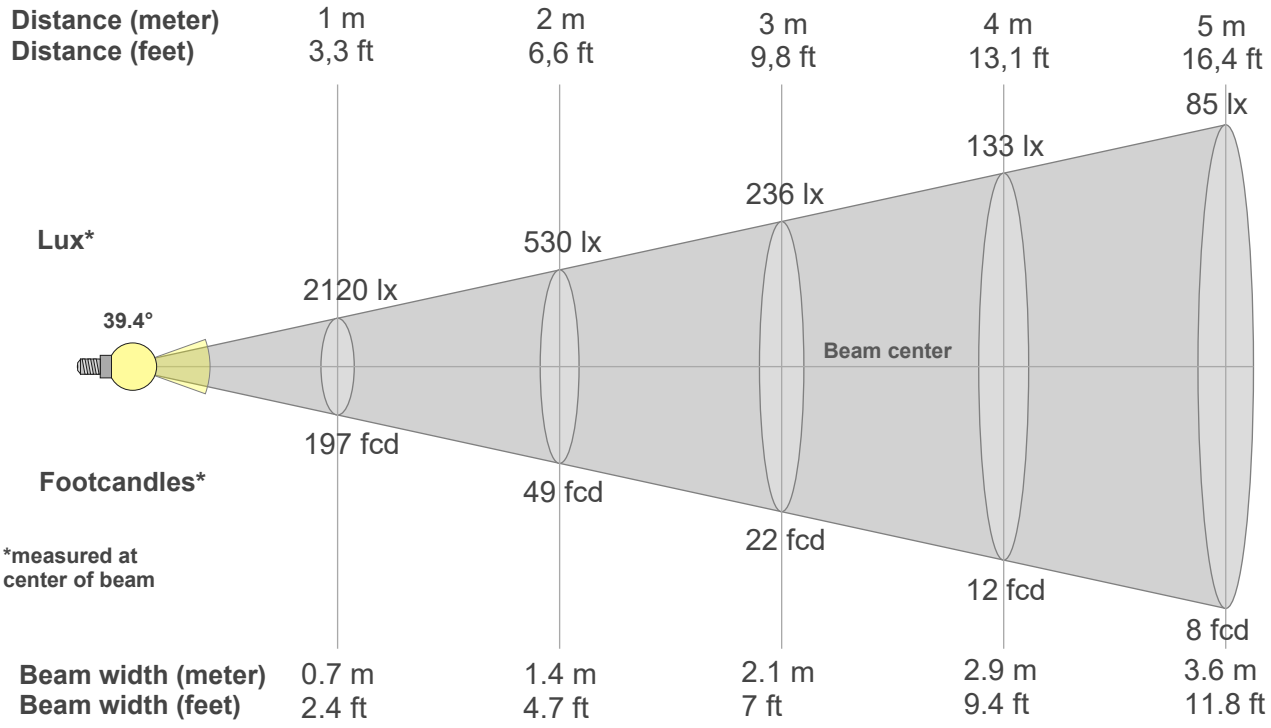

Beam intensities from 1-20m

1m	2m	3m	4m	5m	6m	7m	8m	9m	10m	11m	12m	13m	14m	15m	16m	17m	18m	19m	20m
3.3ft	6.6ft	9.8ft	13.1ft	16.4ft	19.7ft	23ft	26.2ft	29.5ft	32.8ft	36.1ft	39.4ft	42.7ft	45.9ft	49.2ft	52.5ft	55.8ft	59.1ft	62.3ft	65.6ft
2120lx	530lx	236lx	133lx	85lx	59lx	43lx	33lx	26lx	21lx	18lx	15lx	13lx	11lx	9lx	8lx	7lx	7lx	6lx	5lx
197fcd	49.2fcd	21.9fcd	12.3fcd	7.9fcd	5.5fcd	4fcd	3.1fcd	2.4fcd	2fcd	1.6fcd	1.4fcd	1.2fcd	1fcd	0.9fcd	0.8fcd	0.7fcd	0.6fcd	0.5fcd	0.5fcd

Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°
2120	2107	2070	2019	1927	1835	1696	1552	1389	1212	1036	866	695	563	436	336	259	189	149	108
100%	99%	98%	95%	91%	87%	80%	73%	66%	57%	49%	41%	33%	27%	21%	16%	12%	9%	7%	5%

Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°
2120	2113	2061	2008	1914	1813	1689	1542	1391	1215	1040	873	709	565	445	331	260	190	147	112
100%	100%	97%	95%	90%	85%	80%	73%	66%	57%	49%	41%	33%	27%	21%	16%	12%	9%	7%	5%

Intensities in 180° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°
2120	2099	2075	2001	1928	1816	1691	1549	1381	1213	1035	858	701	553	423	327	231	180	129	96
100%	99%	98%	94%	91%	86%	80%	73%	65%	57%	49%	40%	33%	26%	20%	15%	11%	8%	6%	5%

Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°
2120	2117	2089	2032	1967	1850	1732	1574	1404	1226	1038	853	693	532	413	307	223	166	112	88
100%	100%	99%	96%	93%	87%	82%	74%	66%	58%	49%	40%	33%	25%	19%	15%	10%	8%	5%	4%


Beam angle 50%	Field angle 10%	Cutoff angle 2,5%	Intensity ratio in 120° cone	Intensity ratio in 90° cone
39.4°	**65.8°**	**85.1°**	**98.6%**	**96.5%**

www.specialty-lighting.com As a result of our continuous improvement, values are subject to change without notice. These are delivered results and can vary +/- 10% from published source data range.

specialty lighting industries

Light planning

Luminaire budgetary diagram

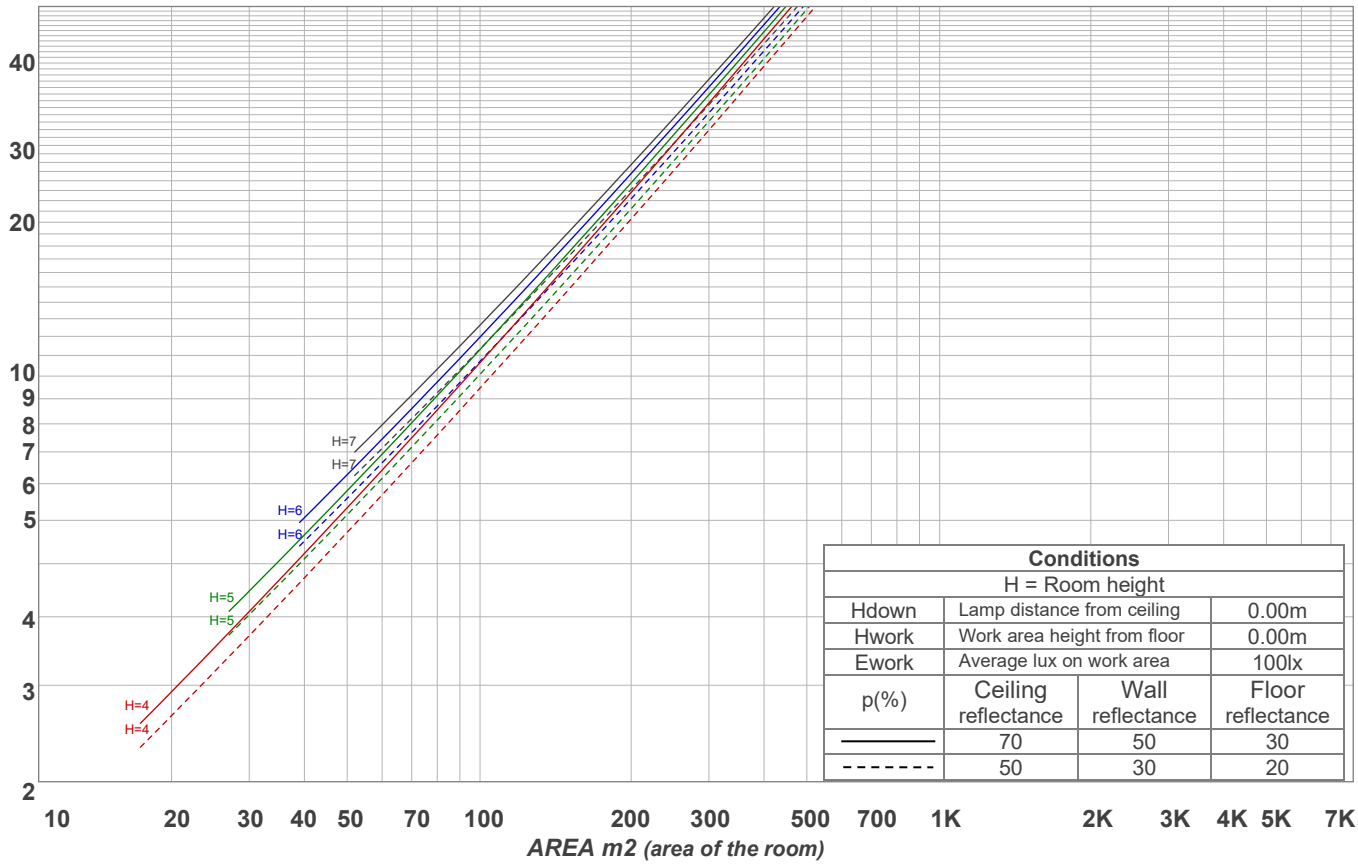

Conditions		
H = Room height		
Hdown	Lamp distance from ceiling	0.00m
Hwork	Work area height from floor	0.00m
Ework	Average lux on work area	100lx
p(%)	Ceiling reflectance	Wall reflectance	Floor reflectance
———	70	50	30
- - - - - - -	50	30	20

Luminaire budgetary diagram

AREA m2 (area of the room)

Coefficients of Utilization

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio)				Room Values are expressed as percentage of Lumens delivered to the task surface													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	107	112	109	107	105	105	104	102	102	100	99	98	97	96	94
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	92	91	89
3	104	99	94	91	103	97	93	90	95	91	89	92	90	87	90	88	86	84
4	100	93	88	85	98	92	88	84	90	86	83	88	85	82	86	84	81	80
5	96	89	83	80	94	88	83	79	86	82	79	84	81	78	83	80	77	76
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72
7	88	80	75	71	87	80	75	71	78	74	71	77	73	70	76	73	70	69
8	85	77	71	68	84	76	71	68	75	71	67	74	70	67	73	70	67	66
9	82	73	68	65	81	73	68	65	72	68	64	71	67	64	70	67	64	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
189 lm	403 lm	285 lm	102 lm	31.8 lm	10.0 lm	6.64 lm	4.97 lm	3.12 lm

90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
0.000 lm	0.000 lm	0.000 lm	0.000 lm	0.000 lm	0.000 lm	0.000 lm	0.000 lm	0.000 lm